


- ROOM TEMPERATURE 25 °C
- FREEZY TEST AT INITIAL BOTTLES TEMPERATURE AT 24°C
- FREEZY TEST AT INITIAL BOTTLES TEMPERATURE AT 13°C
- FREEZY TEST AT INITIAL BOTTLES TEMPERATURE AT 11°C

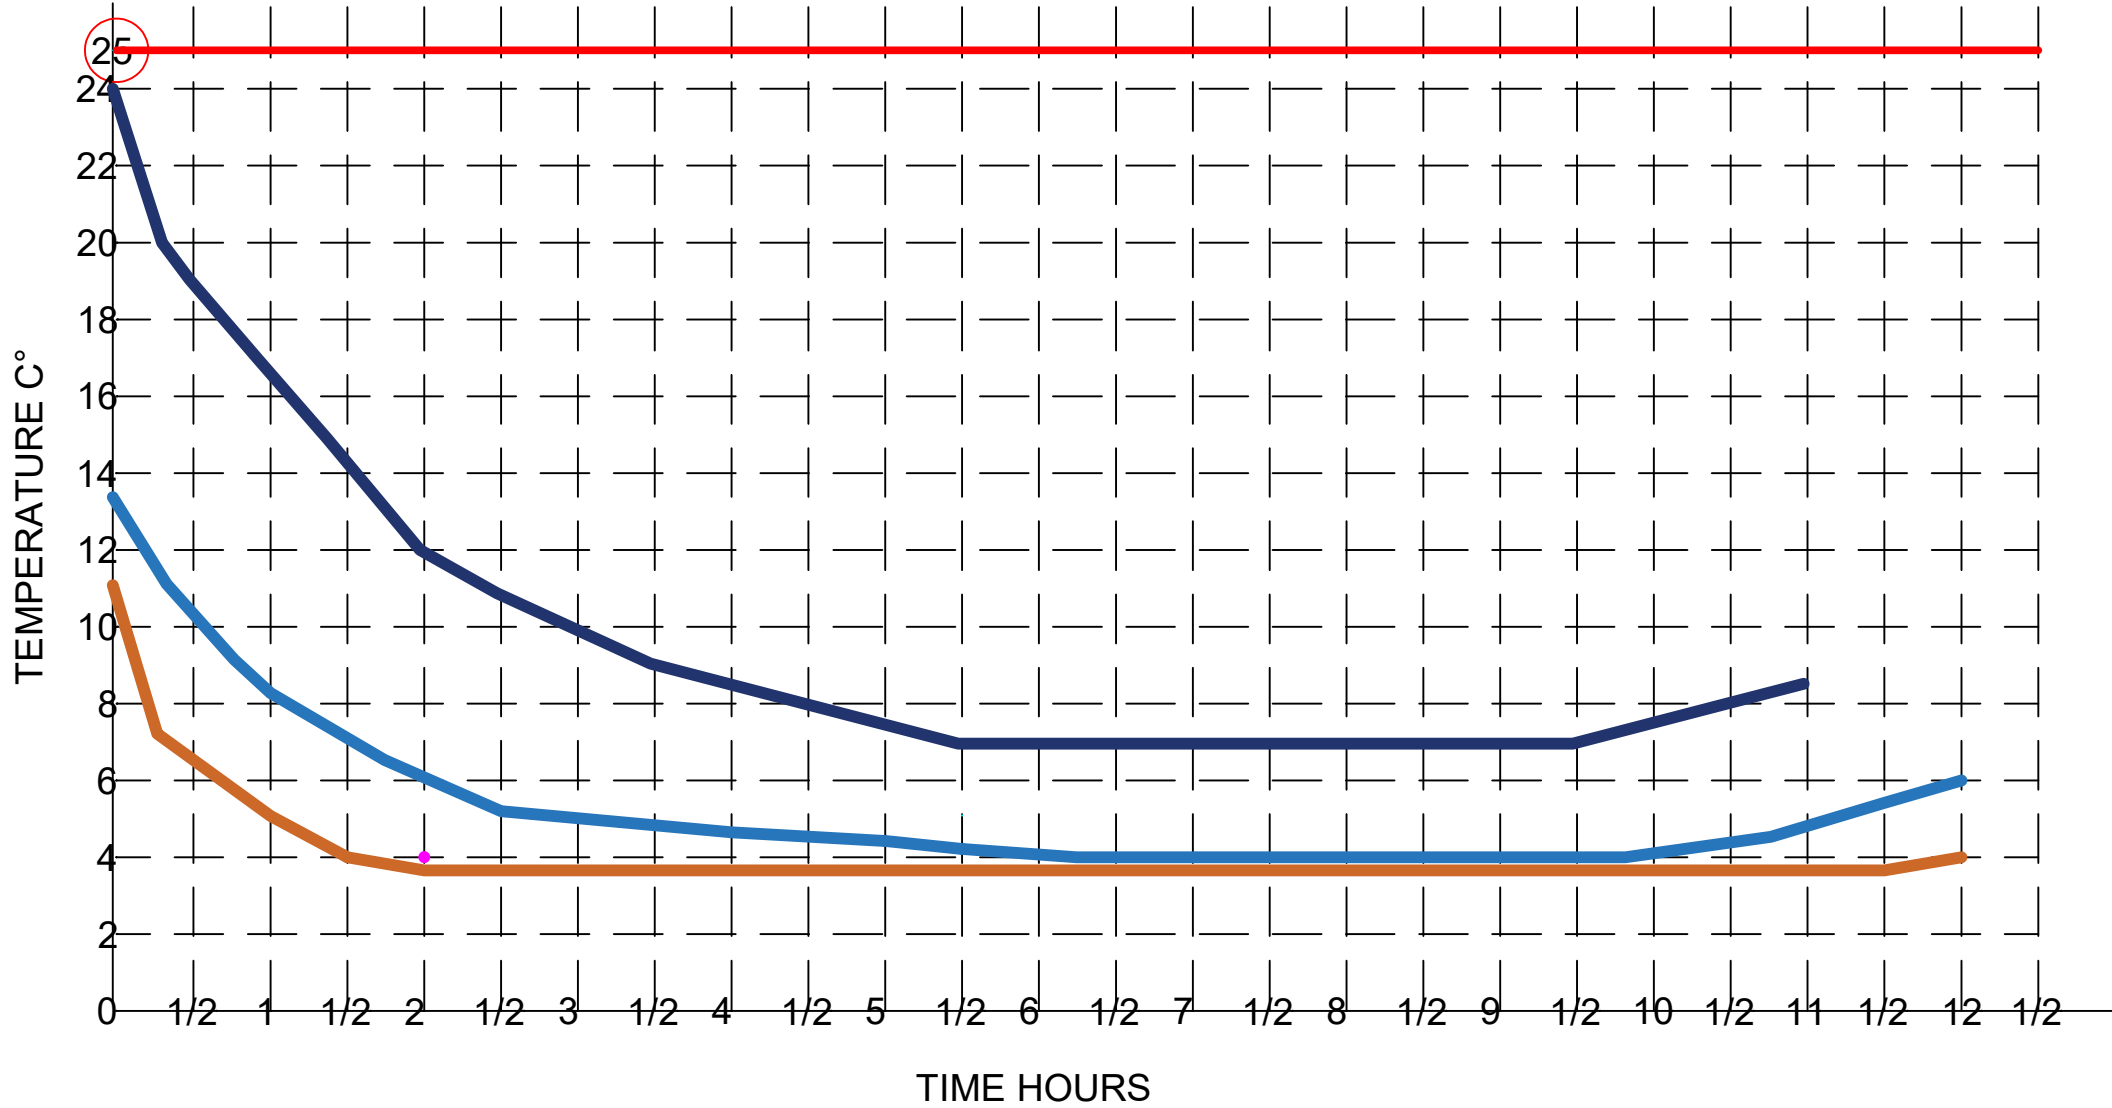

DIAGRAMS OF TESTS TIME - TEMPERATURE C°